


High Power Type

# 150kWh Battery Rack

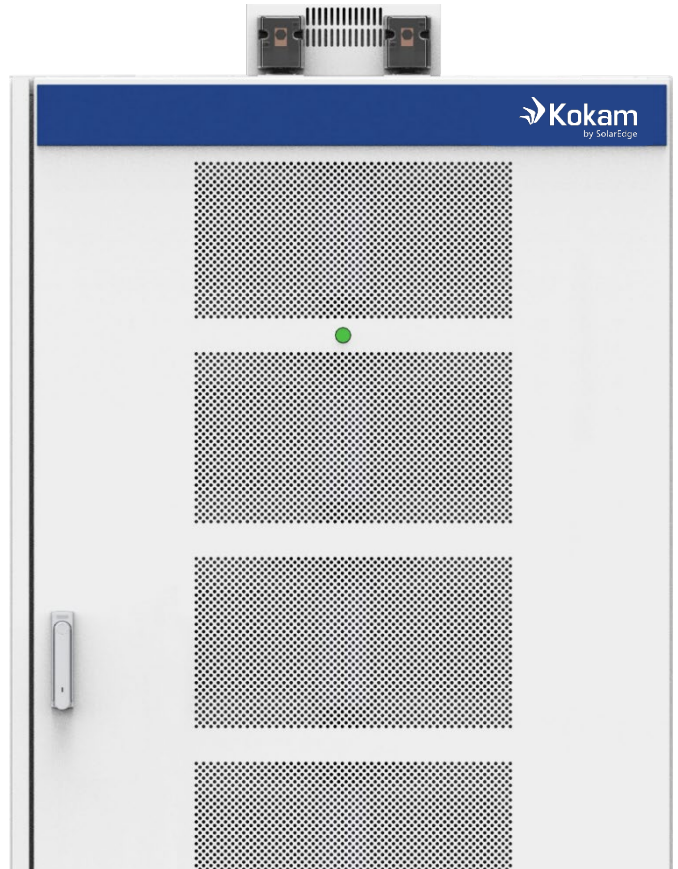

- › Exceptionally high power performance (Up to 900kW)
- › Pre-assembled solution for ease of installation and maintenance
- › Optimized thermal management via air cooling
- › High reliability and unparalleled safety
- › Long cycle and calendar life (Over 8,000 cycles and up to 15 years\*)
- › Scalable up to multiple MWh with virtually no limit
- › Highly intelligent BMS\*\* for sophisticated system control and monitoring

\*Depending on the load profile, the warranty condition may differ

\*\*BMS: Battery Management System

# Battery Rack Specification

**Model: KRI-3C4R-C-240S-HP-150**

Item	Specification	Remarks	
<b>Electrical</b>			
Rack Configuration	12 modules in series	Cell: 125255255G1H (85Ah)	
Installed Energy	150kWh	-	
Usable Energy	138kWh	@ 1P discharge, BOL	
Nominal Voltage	883Vdc	-	
Operating Voltage Range	792~ 991Vdc	-	
Max. Charge Power	435kW	@ 2.9P, 1 Cycle	
Max. Charge Current	493A	@ 2.9C, 1 Cycle	
Rated Charge Power	150kW	@ 1P	
Rated Charge Current	170A	@ 1C	
Peak Discharge Power	900kW	@ 6P, ≤10 sec, ≥SOC 50%	
Peak Discharge Current	1,020A	@ 6C, ≤10 sec, ≥SOC 50%	
Max. Discharge Power	435kW	@ 2.9P, 1 Cycle	
Max. Discharge Current	493A	@ 2.9C, 1 Cycle	
Rated Discharge Power	150kW	@ 1P	
Rated Discharge Current	170A	@ 1C	
Round Trip DC Efficiency	>95%	@ 1P, BOL	
Control Power	AC 100~240V	-	
<b>Mechanical</b>			
Dimension	1,170 (W) x 730 (D) x 1,960 (H) mm	±5%, incl. Fuse Box	
Weight	1,600kg	±5%	
IP Grade	20	-	
<b>Communication</b>			
Communication Interface	Ethernet/RS-485/CAN2.0B	ModBus TCP/ModBus RTU	
Monitoring	RS-232C	-	
<b>Environment</b>			
Operating Temperature	Charge	0 ~ 10°C	@ <0.2P
		10 ~ 35°C	@ <2P
		35 ~ 45°C	@ <1P
	Discharge	0 ~ 55°C	-
Operating Temperature	22~ 28°C	Recommended	
Storage Humidity	<60±25% RH	Non-condensing	
Storage Temperature	1 Year	-20 ~ 25°C	SOC 50±5%
	6 Months	25 ~ 35°C	
	3 Months	35 ~ 45°C	
	<1 Week	45 ~ 60°C	
<b>Expected Cycle &amp; Calendar Life**</b>			
Cycle Life @ DoD 90%	≥6,000 cycles	@ 25 ± 3°C, 1C/1C, SOH 70%	
Cycle Life @ DoD 80%	≥8,000 cycles	@ 25 ± 3°C, 1C/1C, SOH 70%	
Calendar Life	Up to 15 years	-	
<b>Certifications</b>			
Certifications	UL1642, CB, UN38.3	@ Cell level	
	UL1973	@ Cell level, available by 3Q 2020	
	UL9540A	@ Cell level, available by 4Q 2020	

\*P : Power-rate / C : Current-rate

\*\*Depending on the load profile, the warranty condition may differ

## Offered Solution

System Config.*	Installed Energy	Nominal Voltage	Operating Voltage	Rated Charge Power	Rated Discharge Power	Max Charge Power	Max Discharge Power	Max Discharge Current	BCP** Required	No. of Banks***
2 Racks	300kWh	883Vdc	792 ~ 991Vdc	300kW	300kW	870kW	870kW	986A	Y	1
3 Racks	450kWh	883Vdc	792 ~ 991Vdc	450kW	450kW	1305kW	1305kW	1479A	Y	1
4 Racks	600kWh	883Vdc	792 ~ 991Vdc	600kW	600kW	1740kW	1740kW	1972A	Y	1
5 Racks	750kWh	883Vdc	792 ~ 991Vdc	750kW	750kW	2175kW	2175kW	2465A	Y	1
6 Racks	900kWh	883Vdc	792 ~ 991Vdc	900kW	900kW	2610kW	2610kW	2958A	Y	1
7 Racks	1051kWh	883Vdc	792 ~ 991Vdc	1051kW	1051kW	3047kW	3047kW	3451A	Y	1
8 Racks	1201kWh	883Vdc	792 ~ 991Vdc	1201kW	1201kW	3482kW	3482kW	3944A	Y	1
9 Racks	1351kWh	883Vdc	792 ~ 991Vdc	1351kW	1351kW	3917kW	3917kW	4437A	Y	2
10 Racks	1501kWh	883Vdc	792 ~ 991Vdc	1501kW	1501kW	4352kW	4352kW	4930A	Y	2
11 Racks	1651kWh	883Vdc	792 ~ 991Vdc	1651kW	1651kW	4787kW	4787kW	5423A	Y	2
12 Racks	1801kWh	883Vdc	792 ~ 991Vdc	1801kW	1801kW	5222kW	5222kW	5916A	Y	2
13 Racks	1951kWh	883Vdc	792 ~ 991Vdc	1951kW	1951kW	5657kW	5657kW	6409A	Y	2
14 Racks	2102kWh	883Vdc	792 ~ 991Vdc	2102kW	2102kW	6095kW	6095kW	6902A	Y	2
15 Racks	2252kWh	883Vdc	792 ~ 991Vdc	2252kW	2252kW	6530kW	6530kW	7395A	Y	2
16 Racks	2402kWh	883Vdc	792 ~ 991Vdc	2402kW	2402kW	6965kW	6965kW	7888A	Y	2
17 Racks	2552kWh	883Vdc	792 ~ 991Vdc	2552kW	2552kW	7400kW	7400kW	8381A	Y	3
18 Racks	2702kWh	883Vdc	792 ~ 991Vdc	2702kW	2702kW	7835kW	7835kW	8874A	Y	3
19 Racks	2852kWh	883Vdc	792 ~ 991Vdc	2852kW	2852kW	8270kW	8270kW	9367A	Y	3
20 Racks	3002kWh	883Vdc	792 ~ 991Vdc	3002kW	3002kW	8705kW	8705kW	9860A	Y	3
21 Racks	3153kWh	883Vdc	792 ~ 991Vdc	3153kW	3153kW	9143kW	9143kW	10353A	Y	3
22 Racks	3303kWh	883Vdc	792 ~ 991Vdc	3303kW	3303kW	9578kW	9578kW	10846A	Y	3
23 Racks	3453kWh	883Vdc	792 ~ 991Vdc	3453kW	3453kW	10013kW	10013kW	11339A	Y	3
24 Racks	3603kWh	883Vdc	792 ~ 991Vdc	3603kW	3603kW	10448kW	10448kW	11832A	Y	3
25 Racks	3753kWh	883Vdc	792 ~ 991Vdc	3753kW	3753kW	10883kW	10883kW	12325A	Y	4
26 Racks	3903kWh	883Vdc	792 ~ 991Vdc	3903kW	3903kW	11318kW	11318kW	12818A	Y	4
27 Racks	4053kWh	883Vdc	792 ~ 991Vdc	4053kW	4053kW	11753kW	11753kW	13311A	Y	4
28 Racks	4204kWh	883Vdc	792 ~ 991Vdc	4204kW	4204kW	12191kW	12191kW	13804A	Y	4
29 Racks	4354kWh	883Vdc	792 ~ 991Vdc	4354kW	4354kW	12626kW	12626kW	14297A	Y	4
30 Racks	4504kWh	883Vdc	792 ~ 991Vdc	4504kW	4504kW	13061kW	13061kW	14790A	Y	4

\*Depending on customer requirements, more than 30 racks can be connected in parallel.

\*\*BCP: Battery Connection Panel (Incl. switch disconnecter, system BMS)

\*\*\*Depending on operational requirements, the number of Banks may vary. One BCP is required per Bank.

### DISCLAIMERS OF WARRANTIES:

All materials and services on this document are provided "as is" without warranty of any kind, either express or implied, including, but not limited to, the implied warranties of merchantability or fitness for a particular purpose, or the warranty of non-infringement. This document could include technical or other mistakes, inaccuracies or typographical errors. Kokam assumes no responsibility for errors or omissions in the information, documents, software, materials and/or services which are referenced by or linked to this document. Kokam does not grant any express or implied right to any person or business entity under any patents, copyrights, trademarks, or trade secret information with respect to the materials and services. No portion of the information or documents may be reproduced in any form or by any means without the prior written consent of kokam. In no event shall kokam be liable to any person or business entity for any special, punitive, incidental, indirect or consequential damages based on any use of this document.